


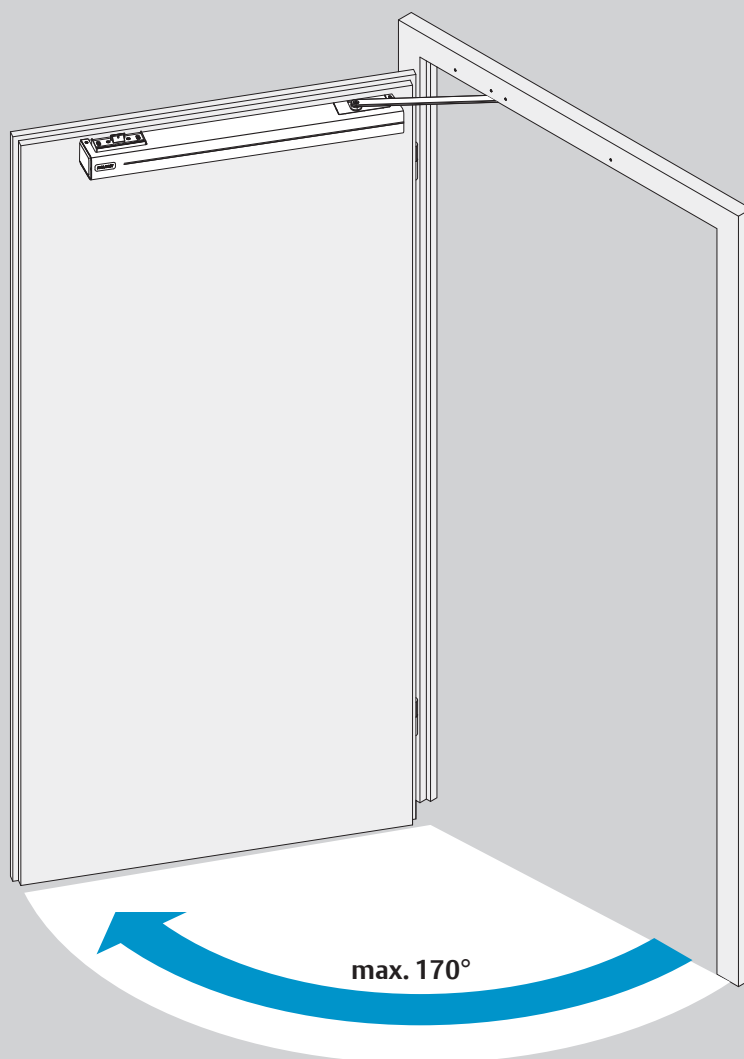
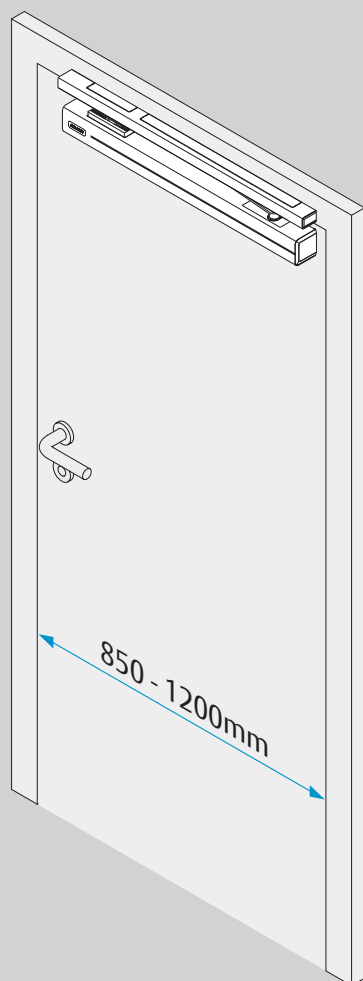
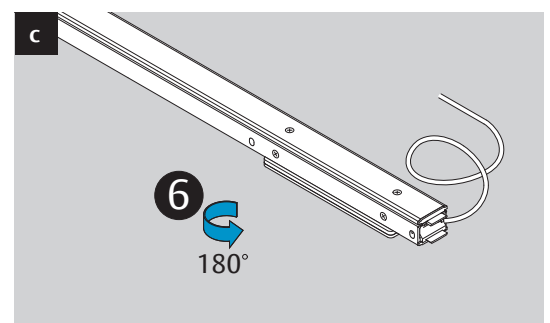
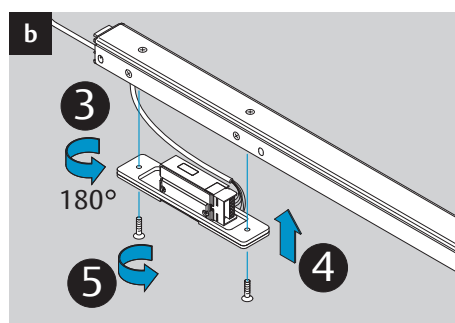
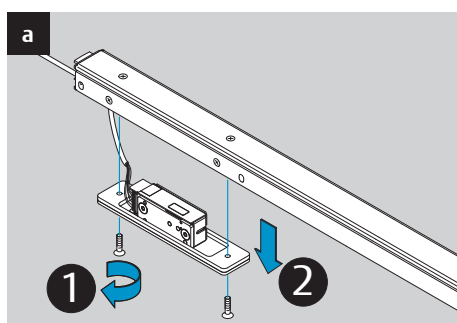
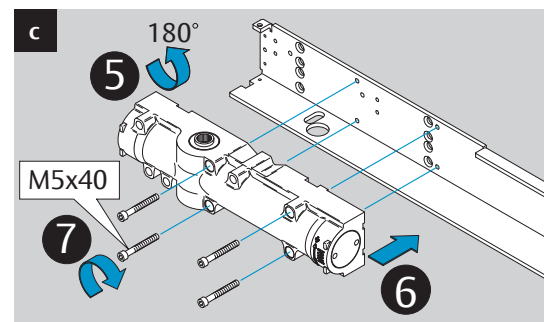
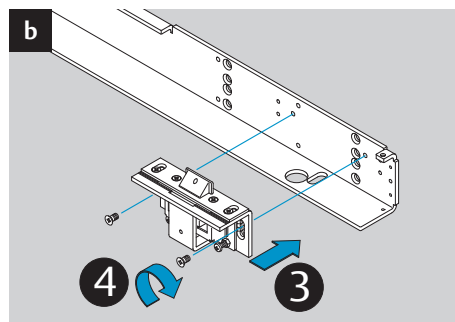
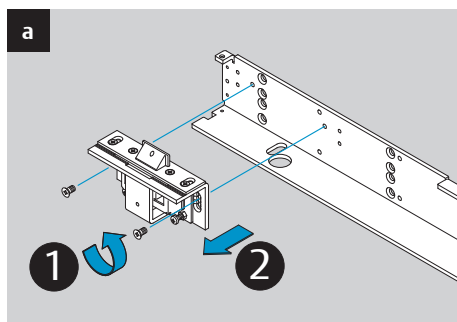
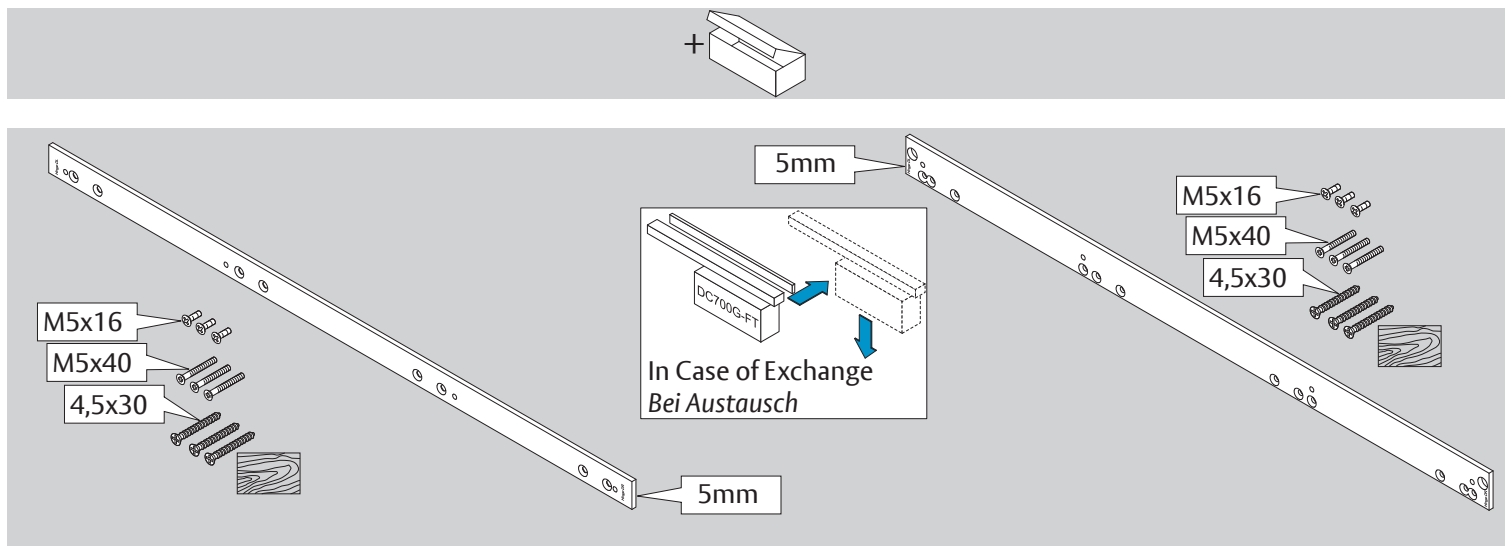
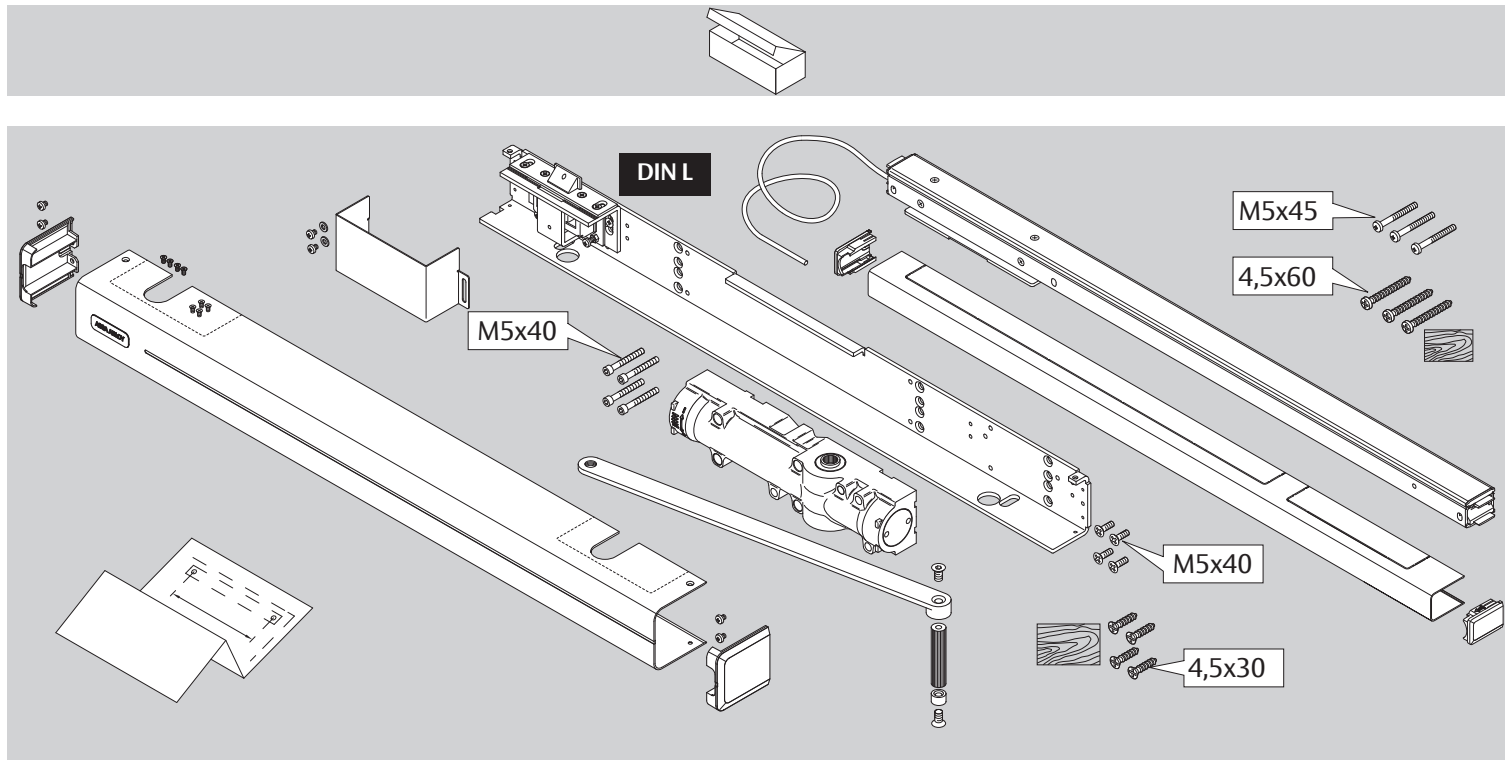
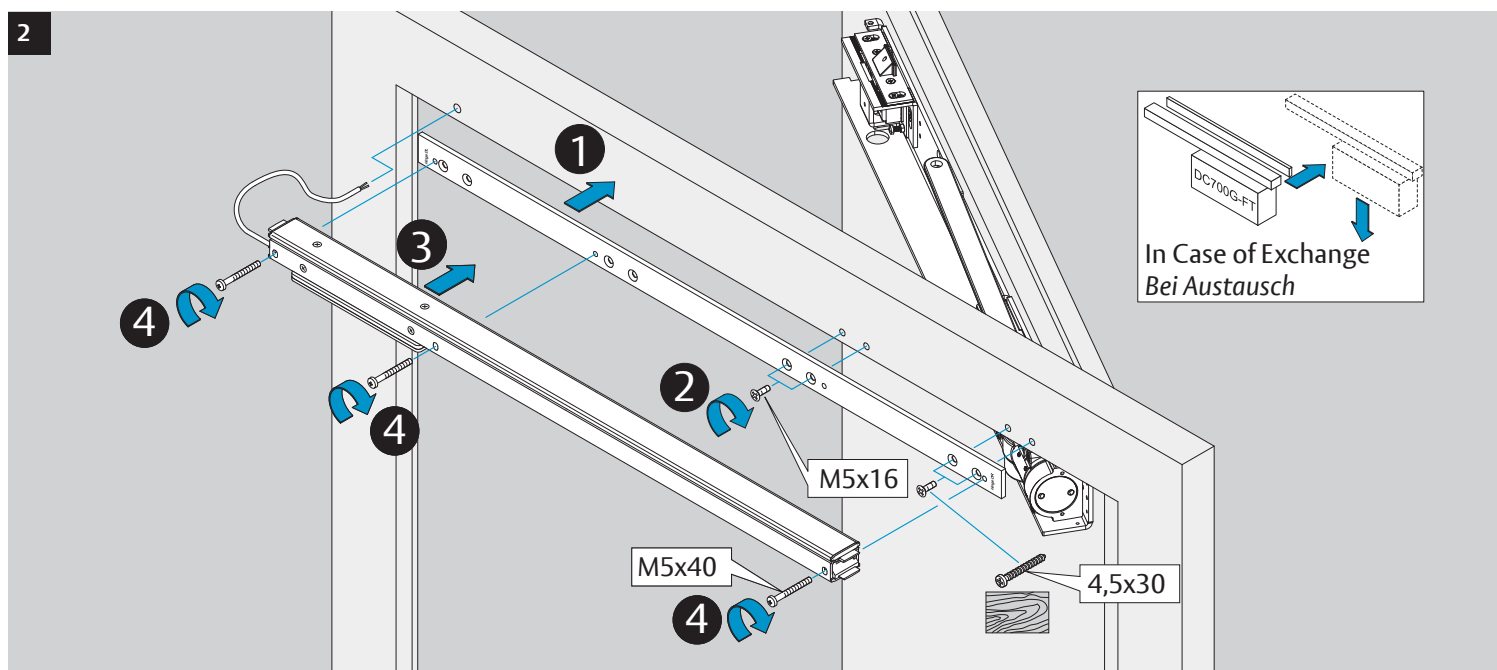
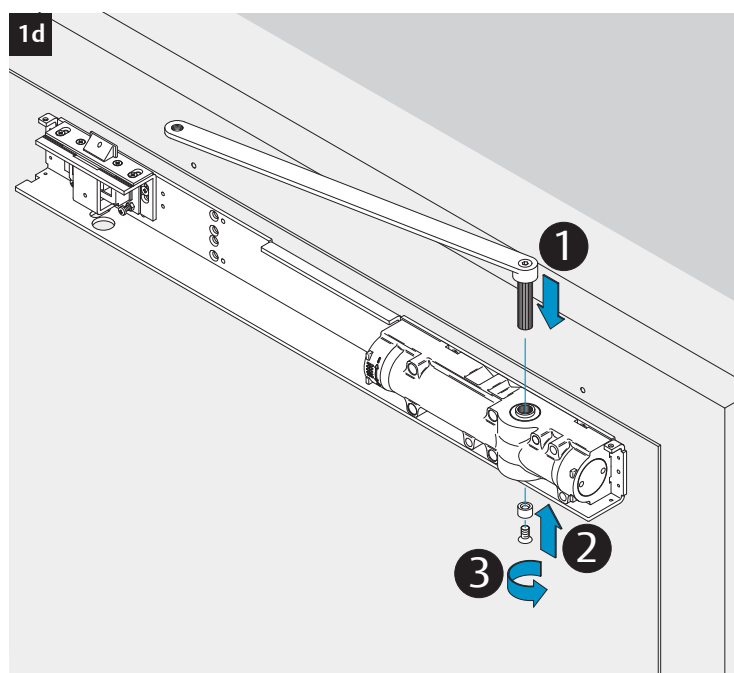
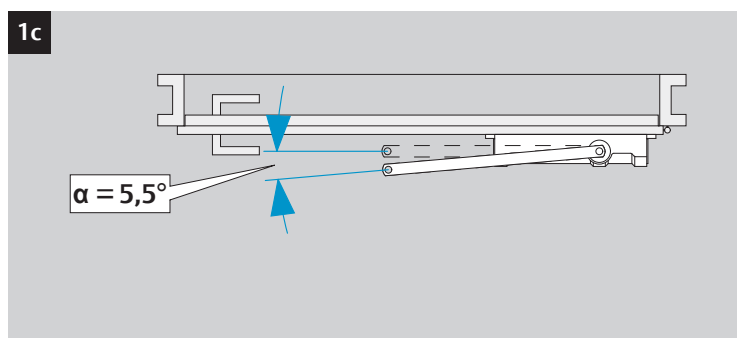


D1005801

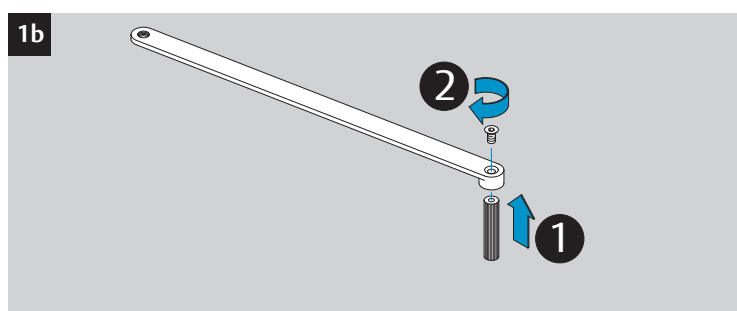


	Abloy Oy, PO Box 108 80101 Joensuu Finland			16			
DC700	EN 1154:1996/A1:2002/AC:2006 1121-CPR-AD5238	3	8	6 3	1	1	4
Dangerous substances: None							

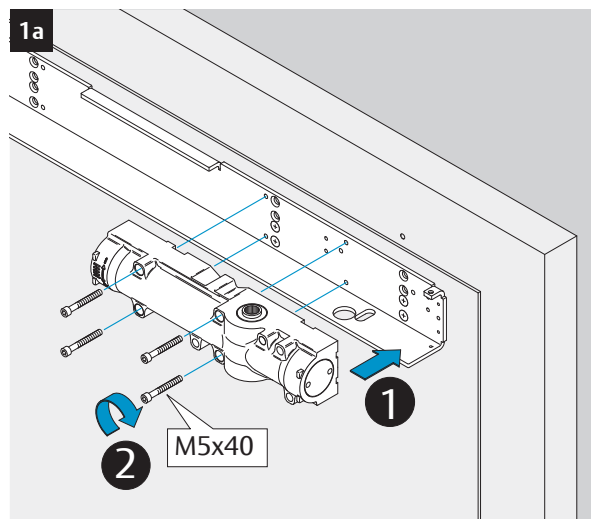

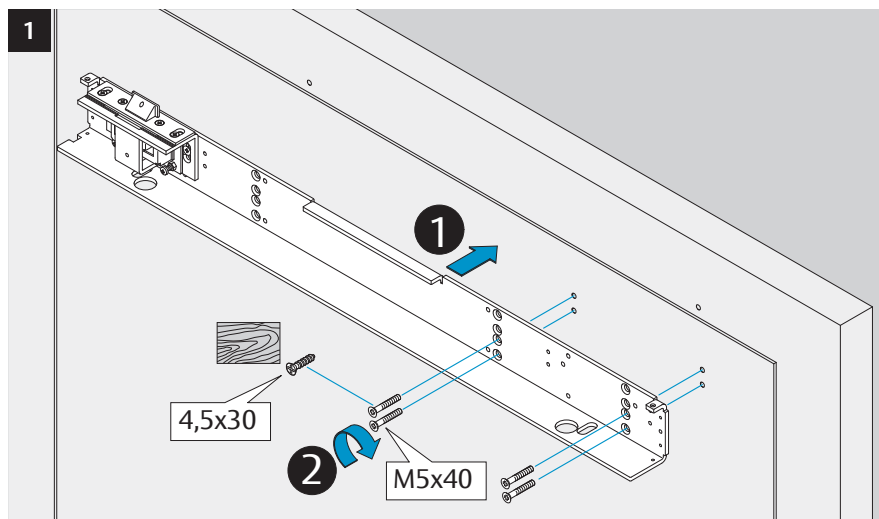





2a

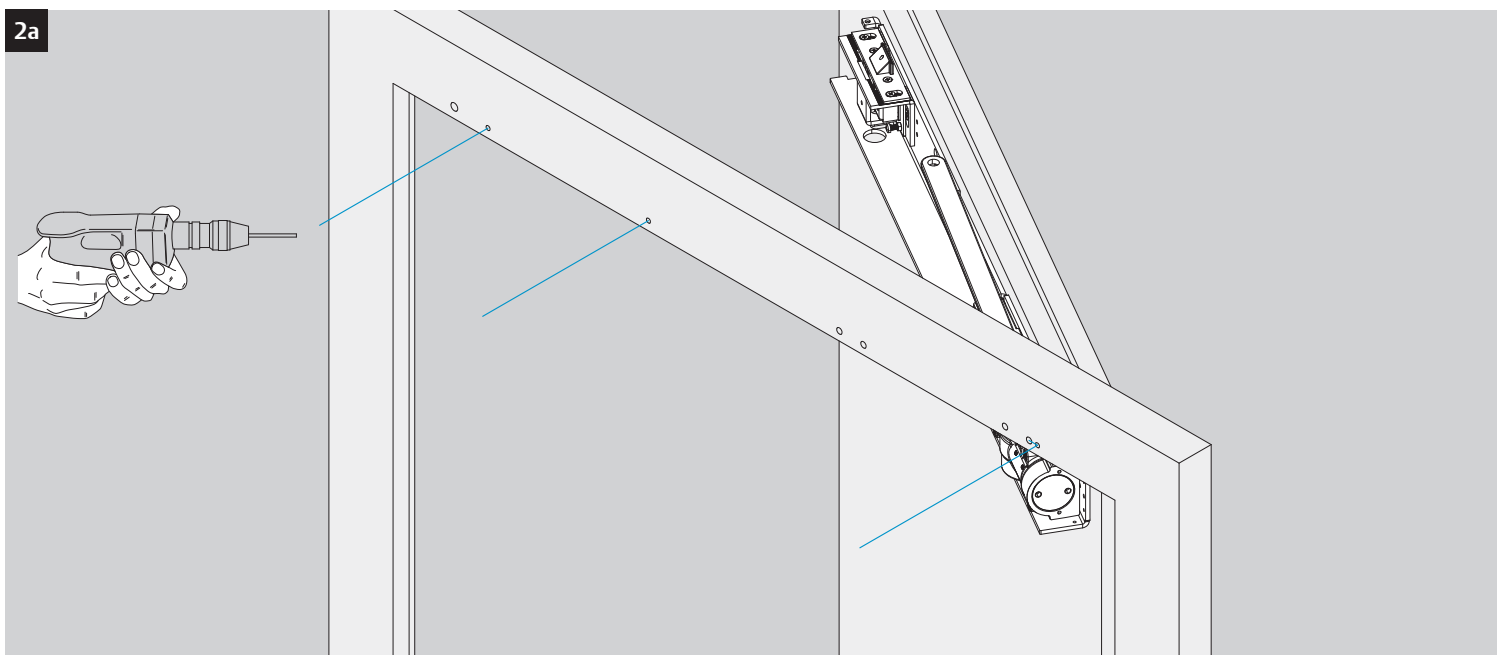


2b






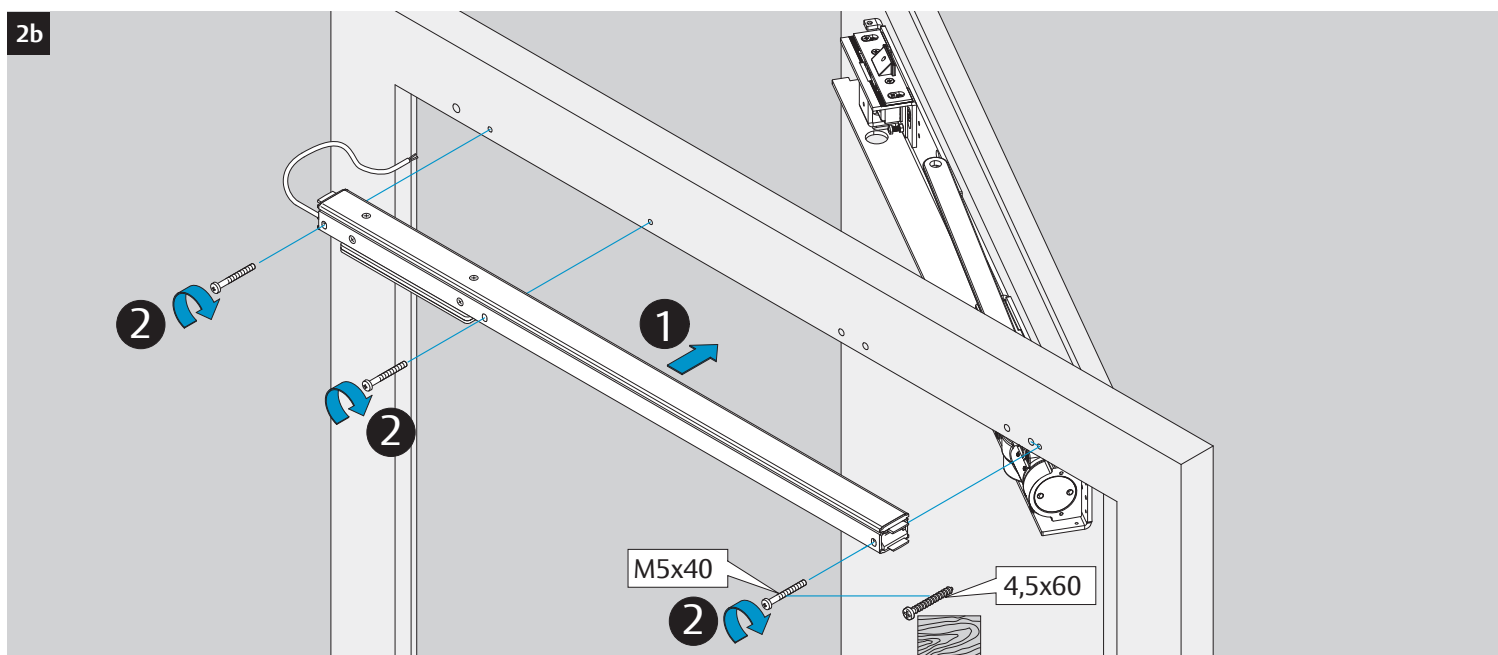












2c

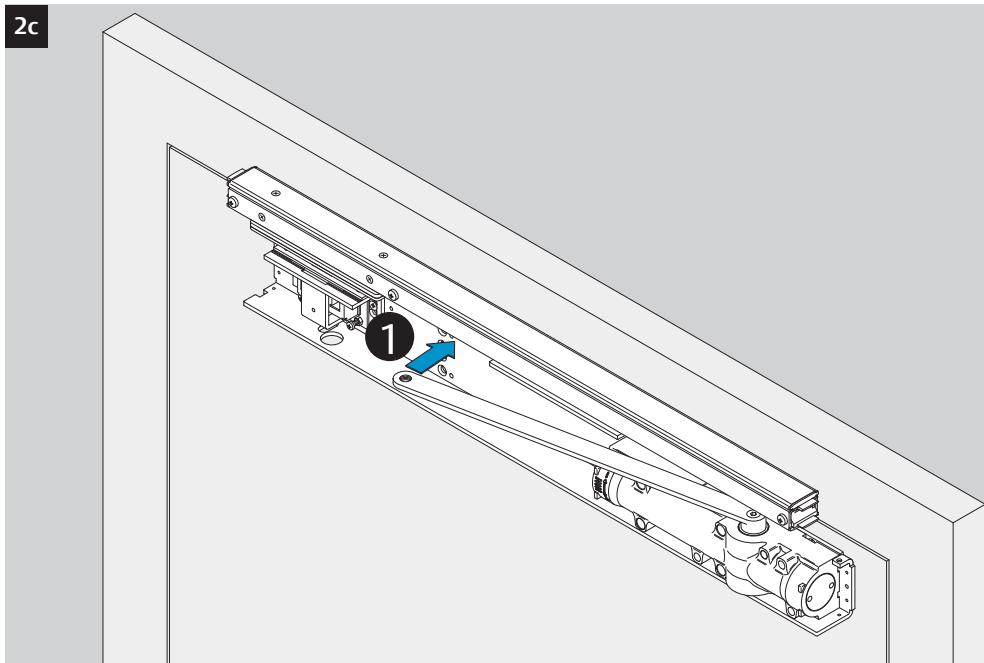

2d

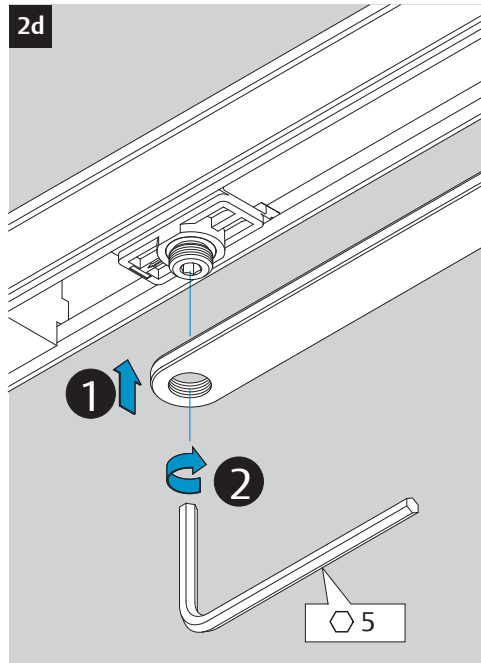


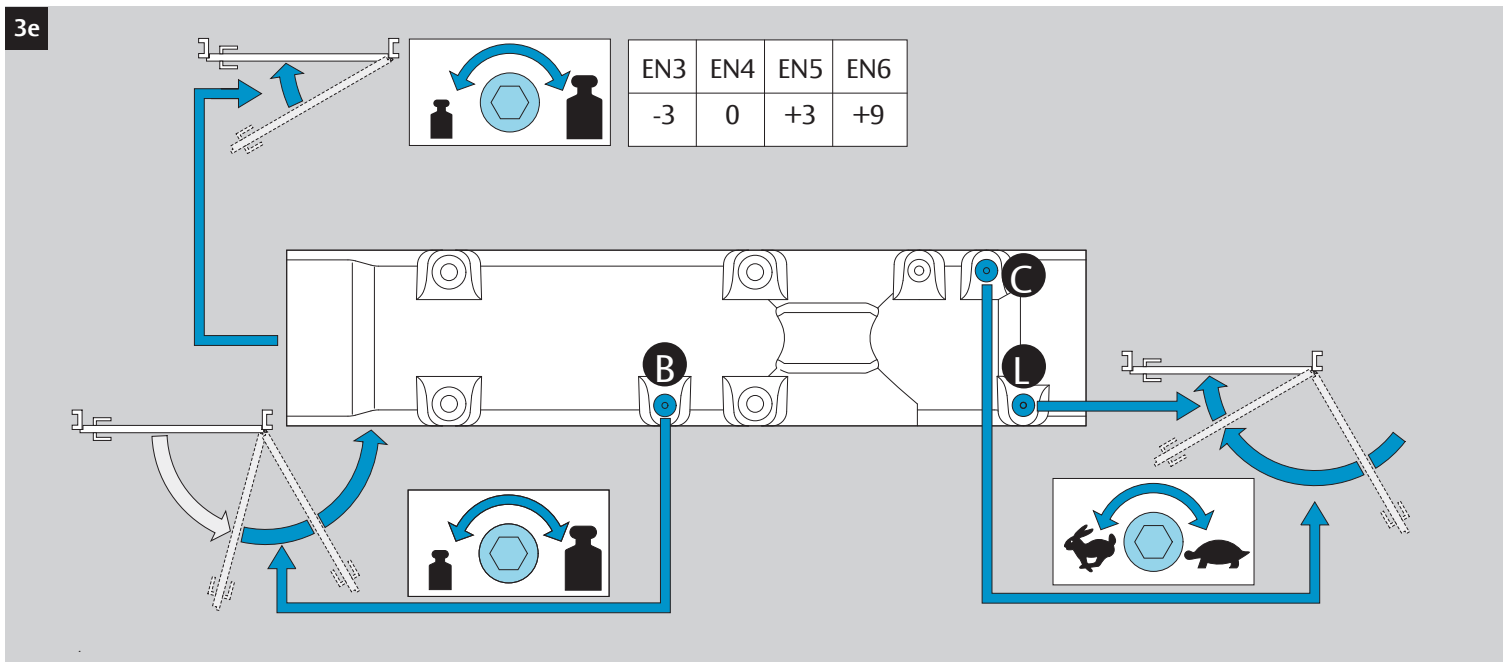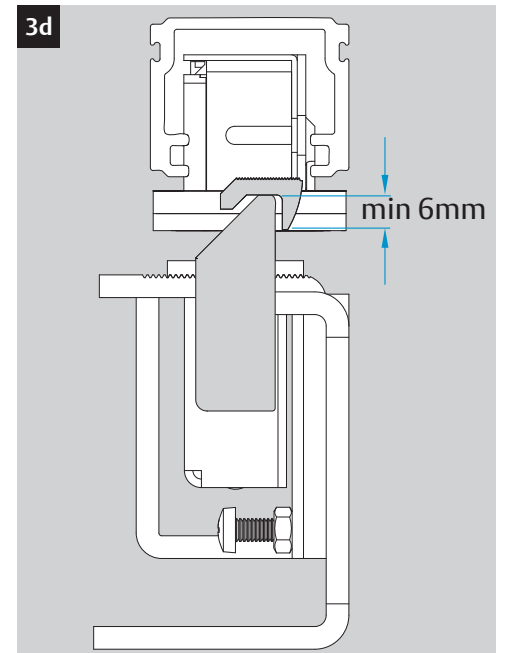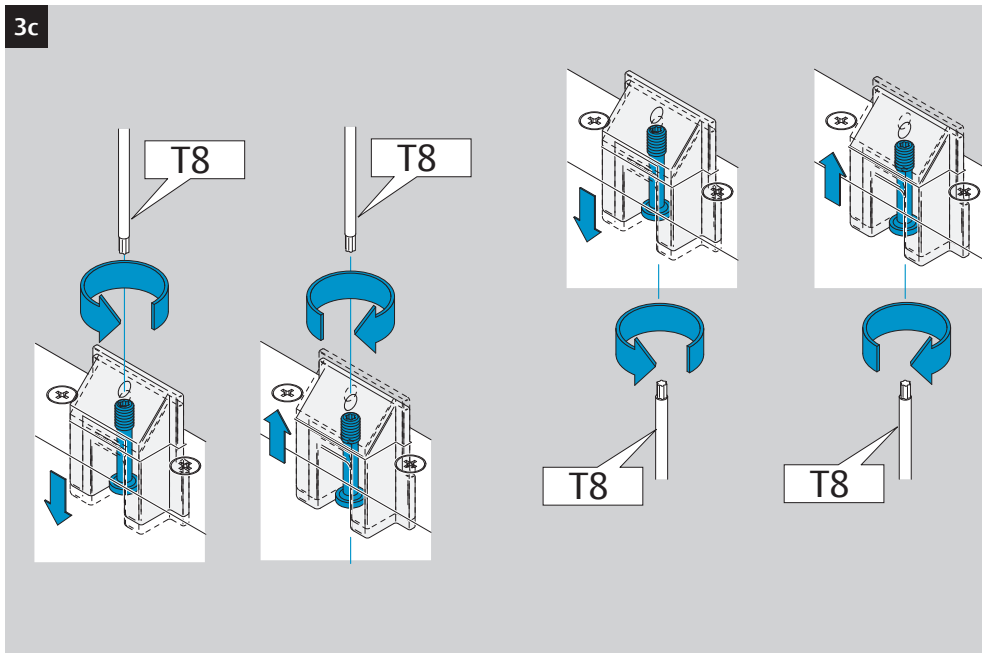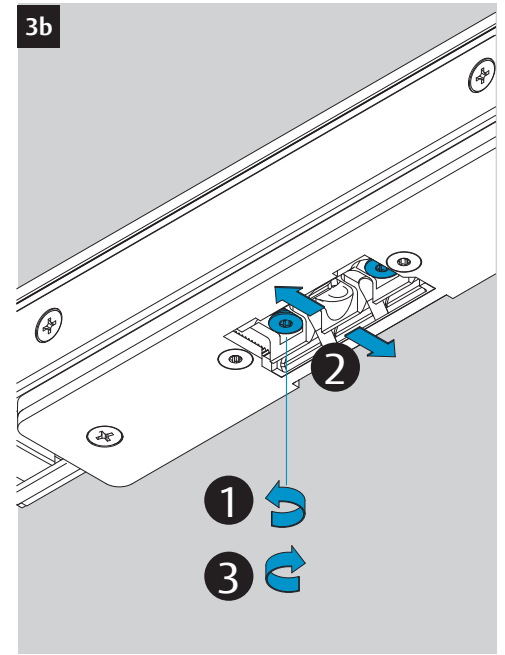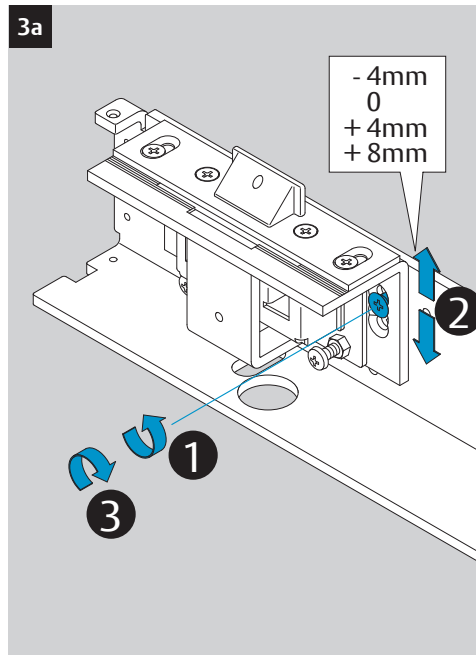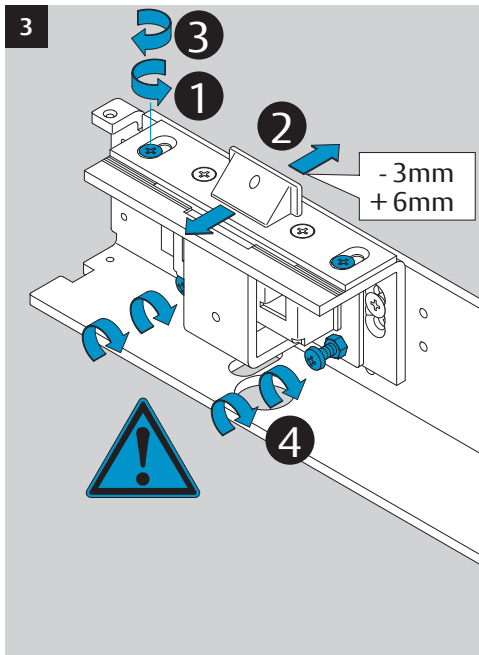

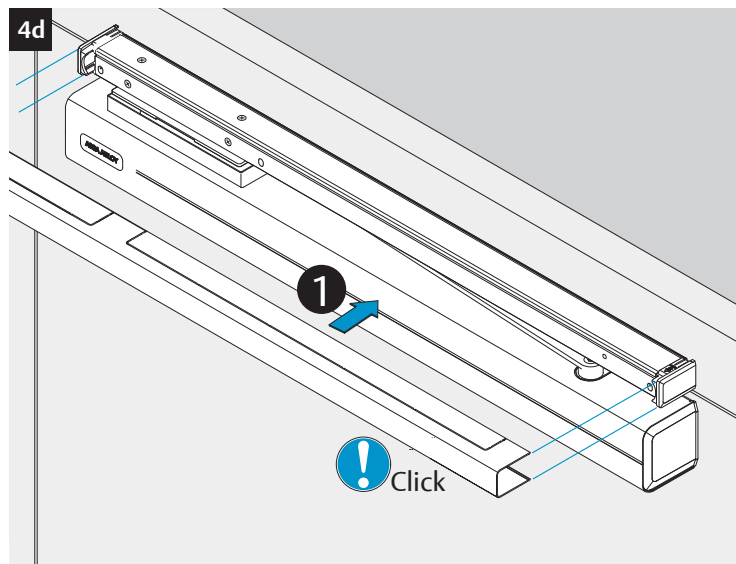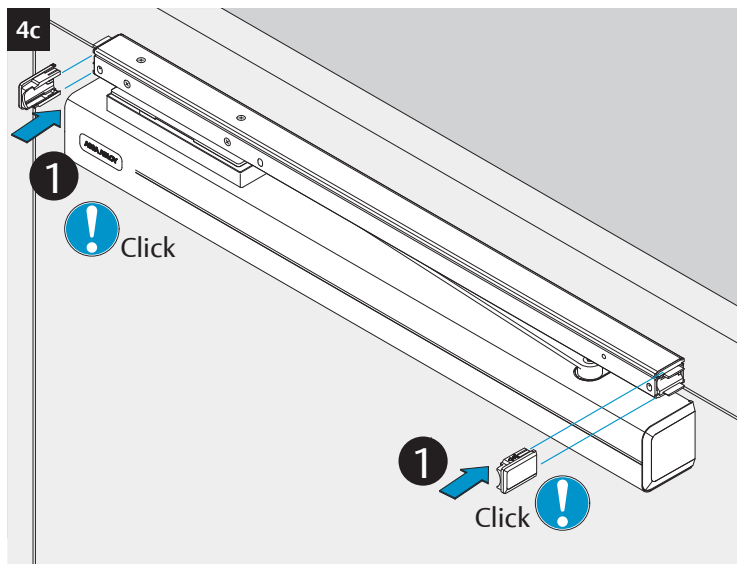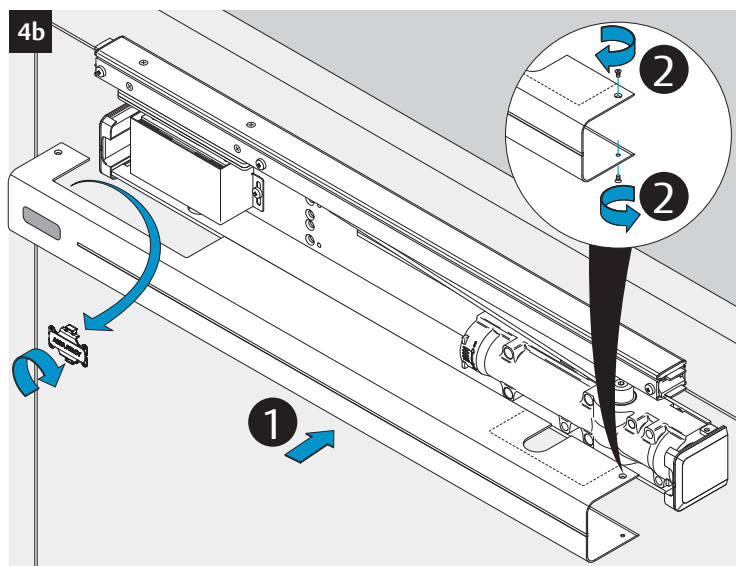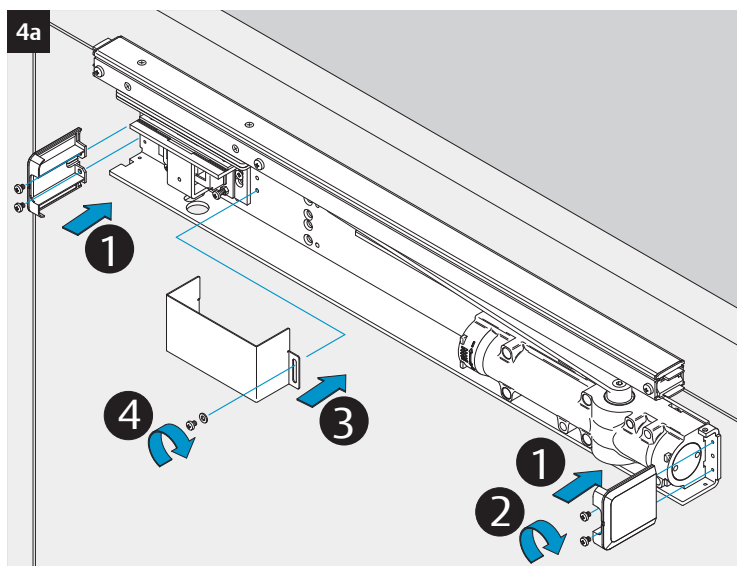
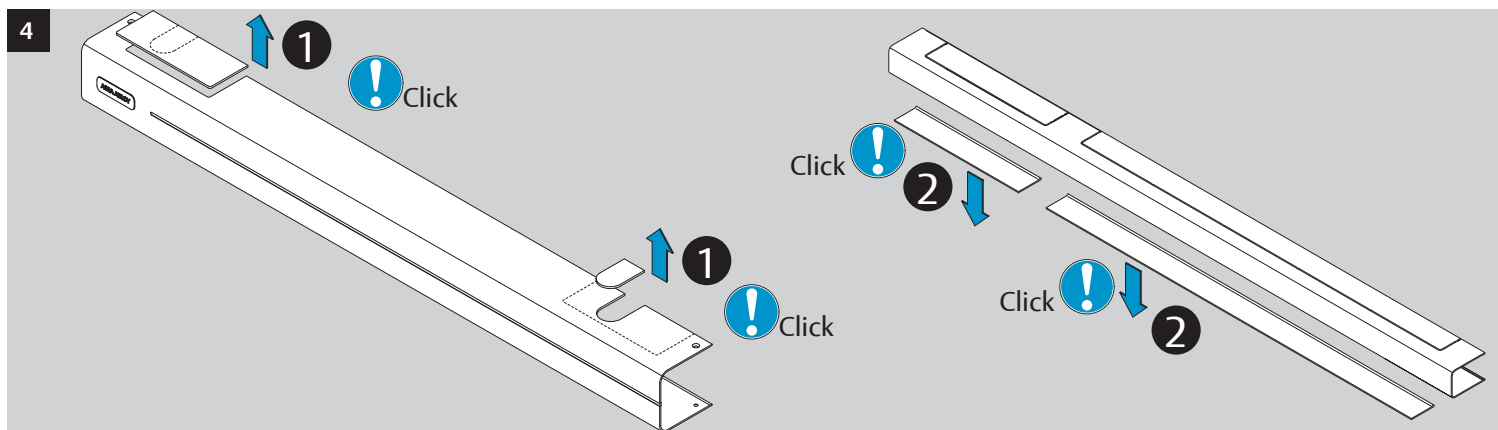




Dimensions Abmessungen

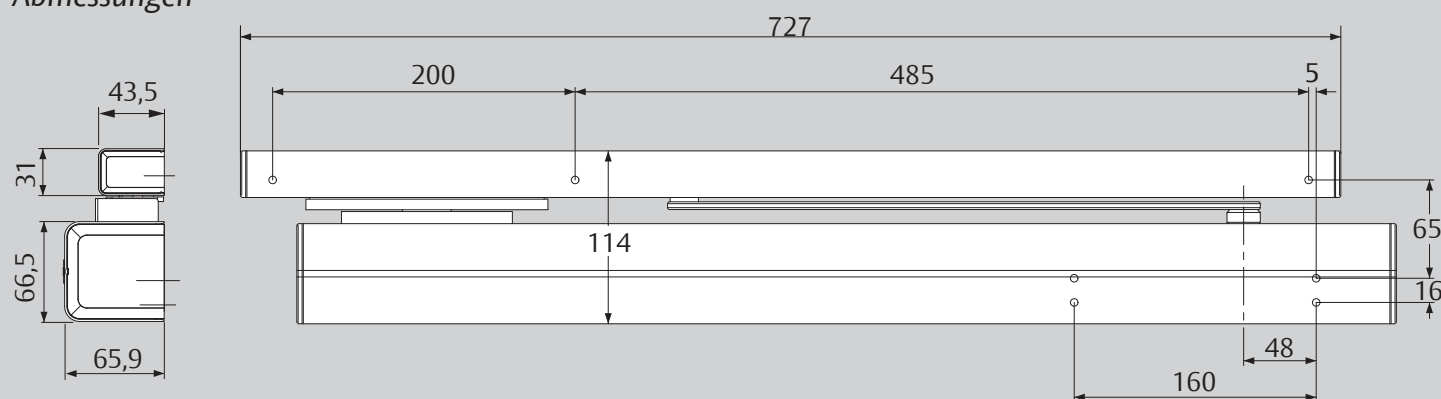


Mounting Dimensions Anschlagmaße

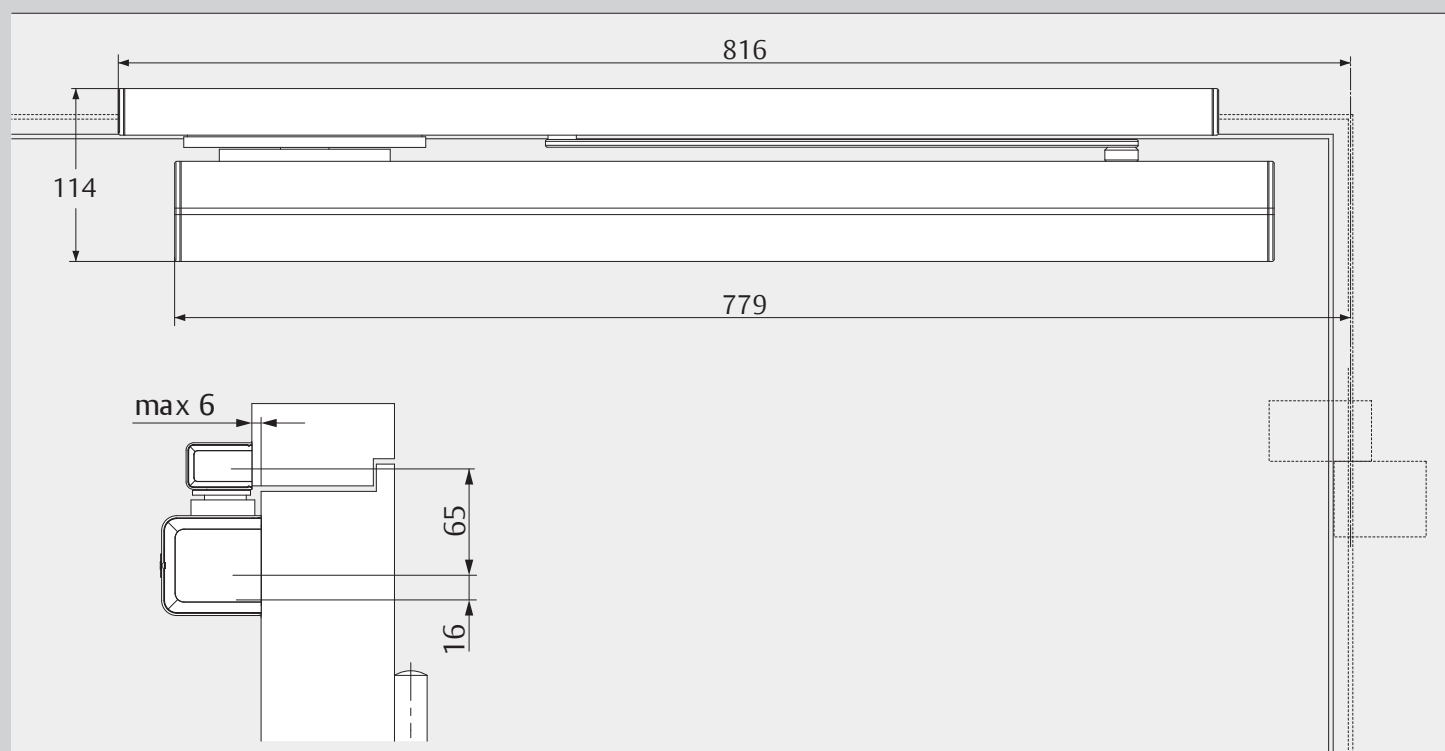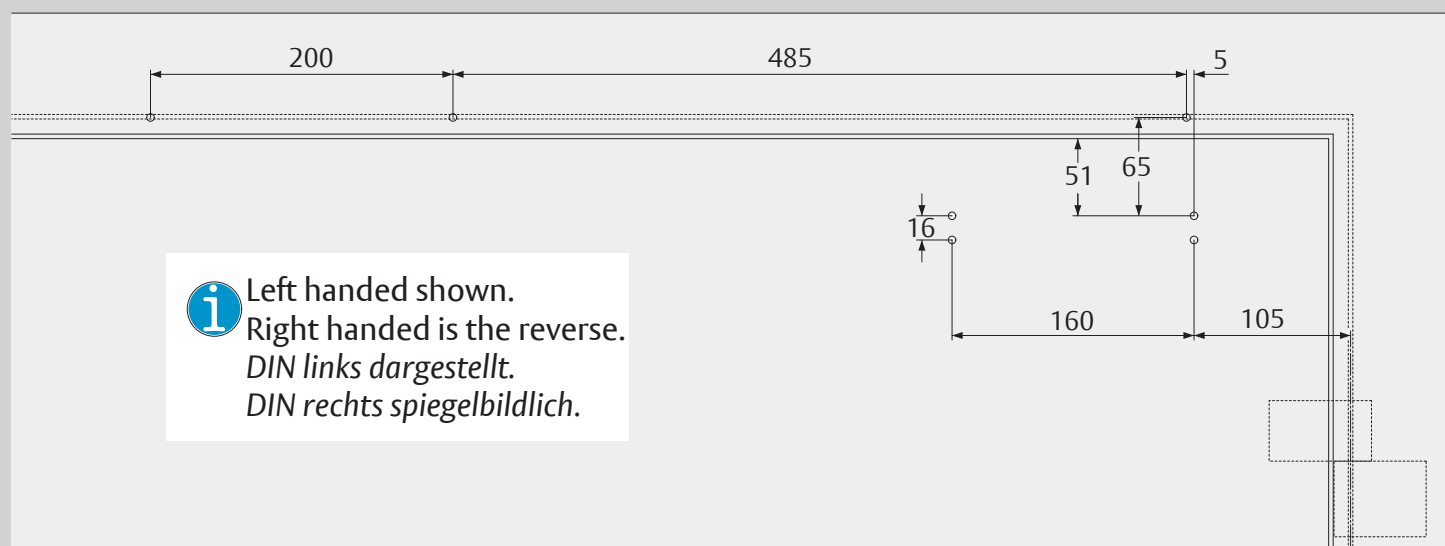




DC700G-FT Type 24 V DC
DC700G-FT Ausführung 24 V DC

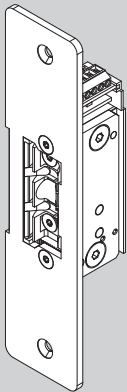


332 ... F91

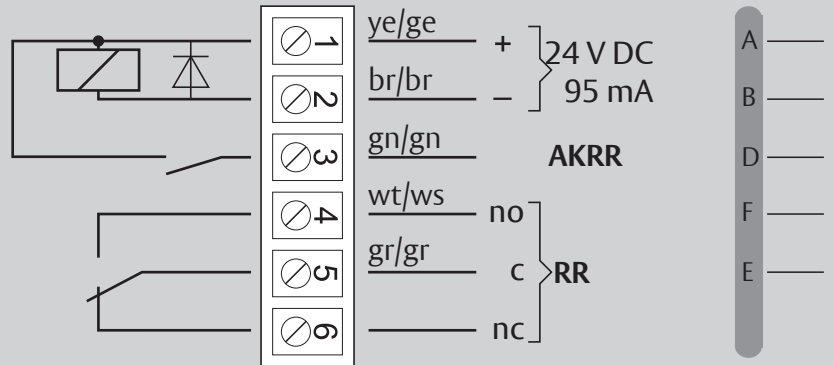


* Connection at effeff Escape Door Control units.
 Anschluss an effeff-Fluchttürsteuergeräte.

⚠ Voltage of Strike and Control unit have to be the same!
 Die Spannungen von Steuergerät und Türöffner müssen identisch sein!

DC700G-FT Type 12 V DC
DC700G-FT Ausführung 12 V DC

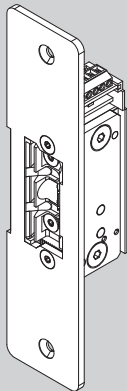

332 ... E91

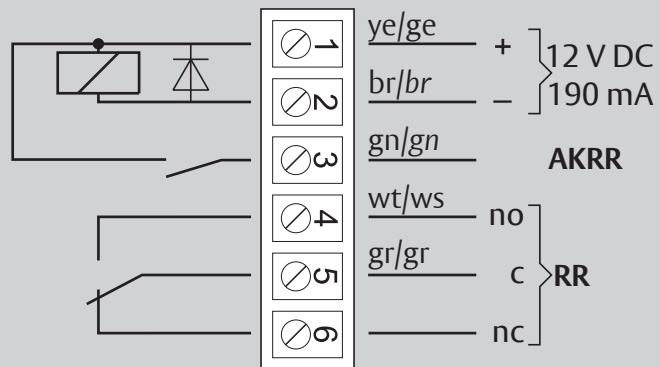

ASSA ABLOY

ASSA ABLOY
 Sicherheitstechnik GmbH

Bildstockstraße 20
 72458 Albstadt
 GERMANY
 Tel.: +49 (0) 74 31-12 3-0
 Fax: +49 (0) 74 31-12 3-24 0
 albstadt@assaabloy.de